


Unit – Gas Water Heater Heater (interior)

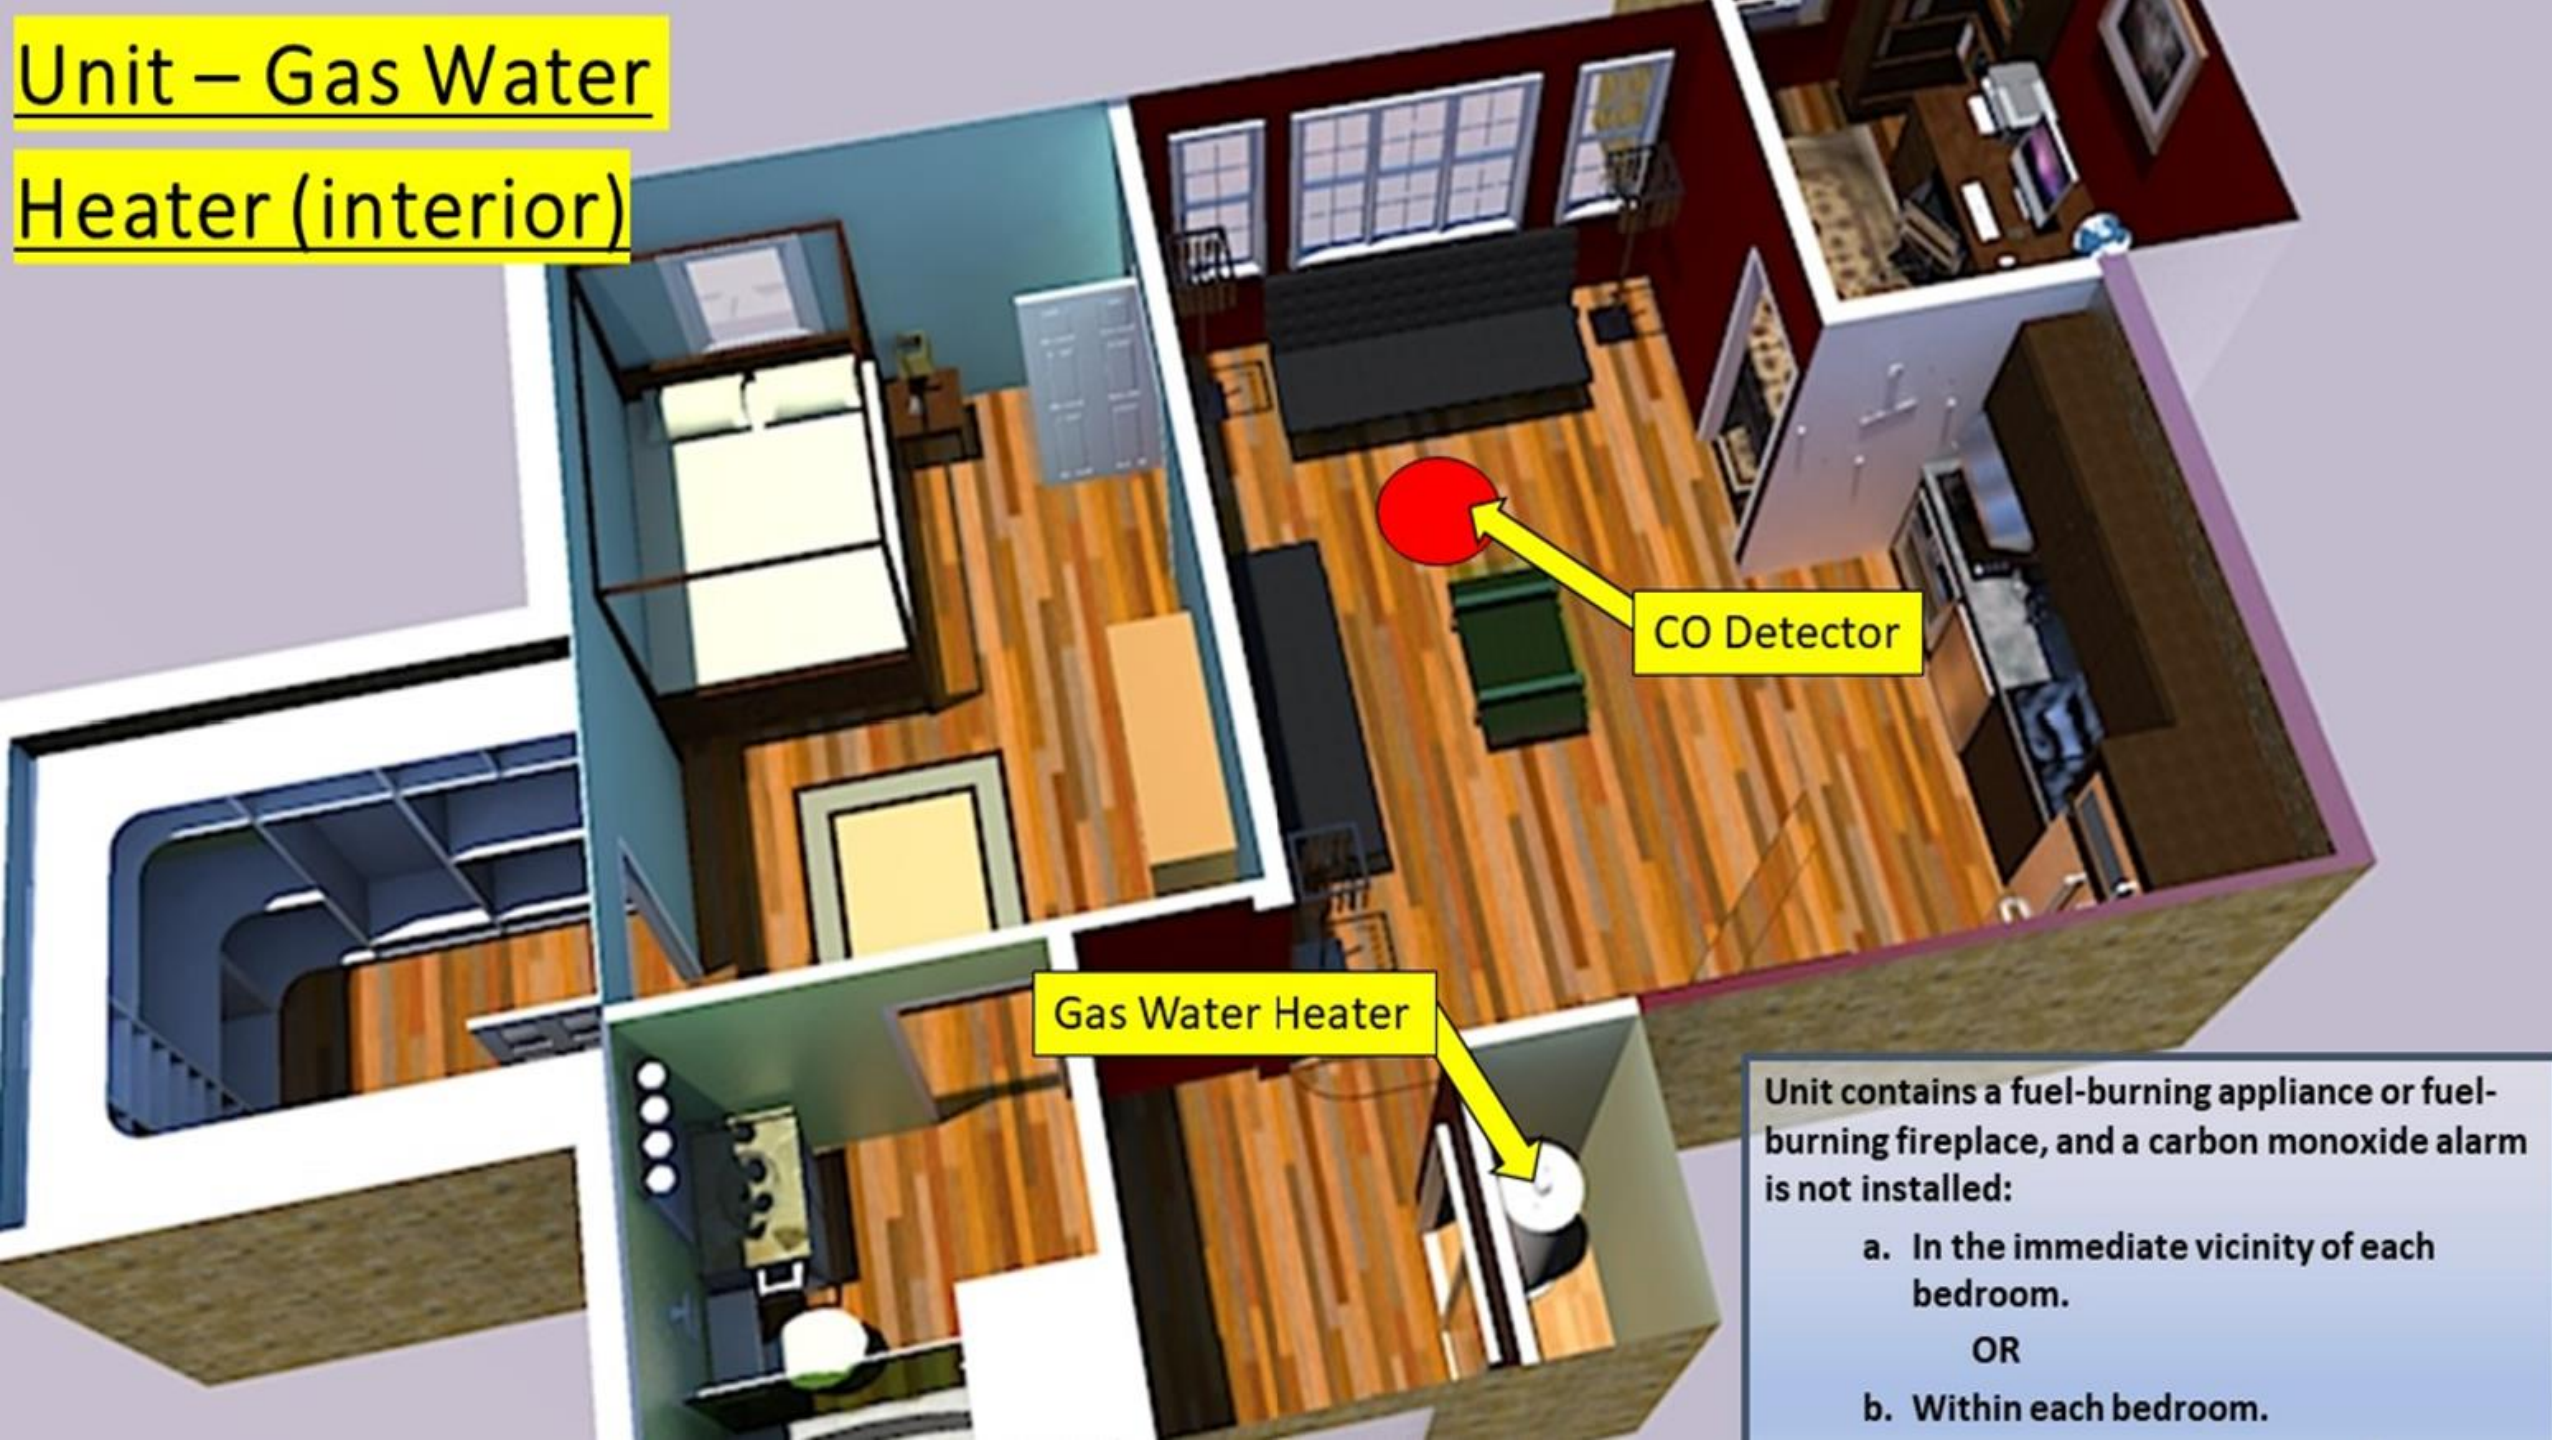


CO Detector

Gas Water Heater

Unit contains a fuel-burning appliance or fuel-burning fireplace, and a carbon monoxide alarm is not installed:

- a. In the immediate vicinity of each bedroom.
- OR
- b. Within each bedroom.

Unit – Gas Water Heater (interior)

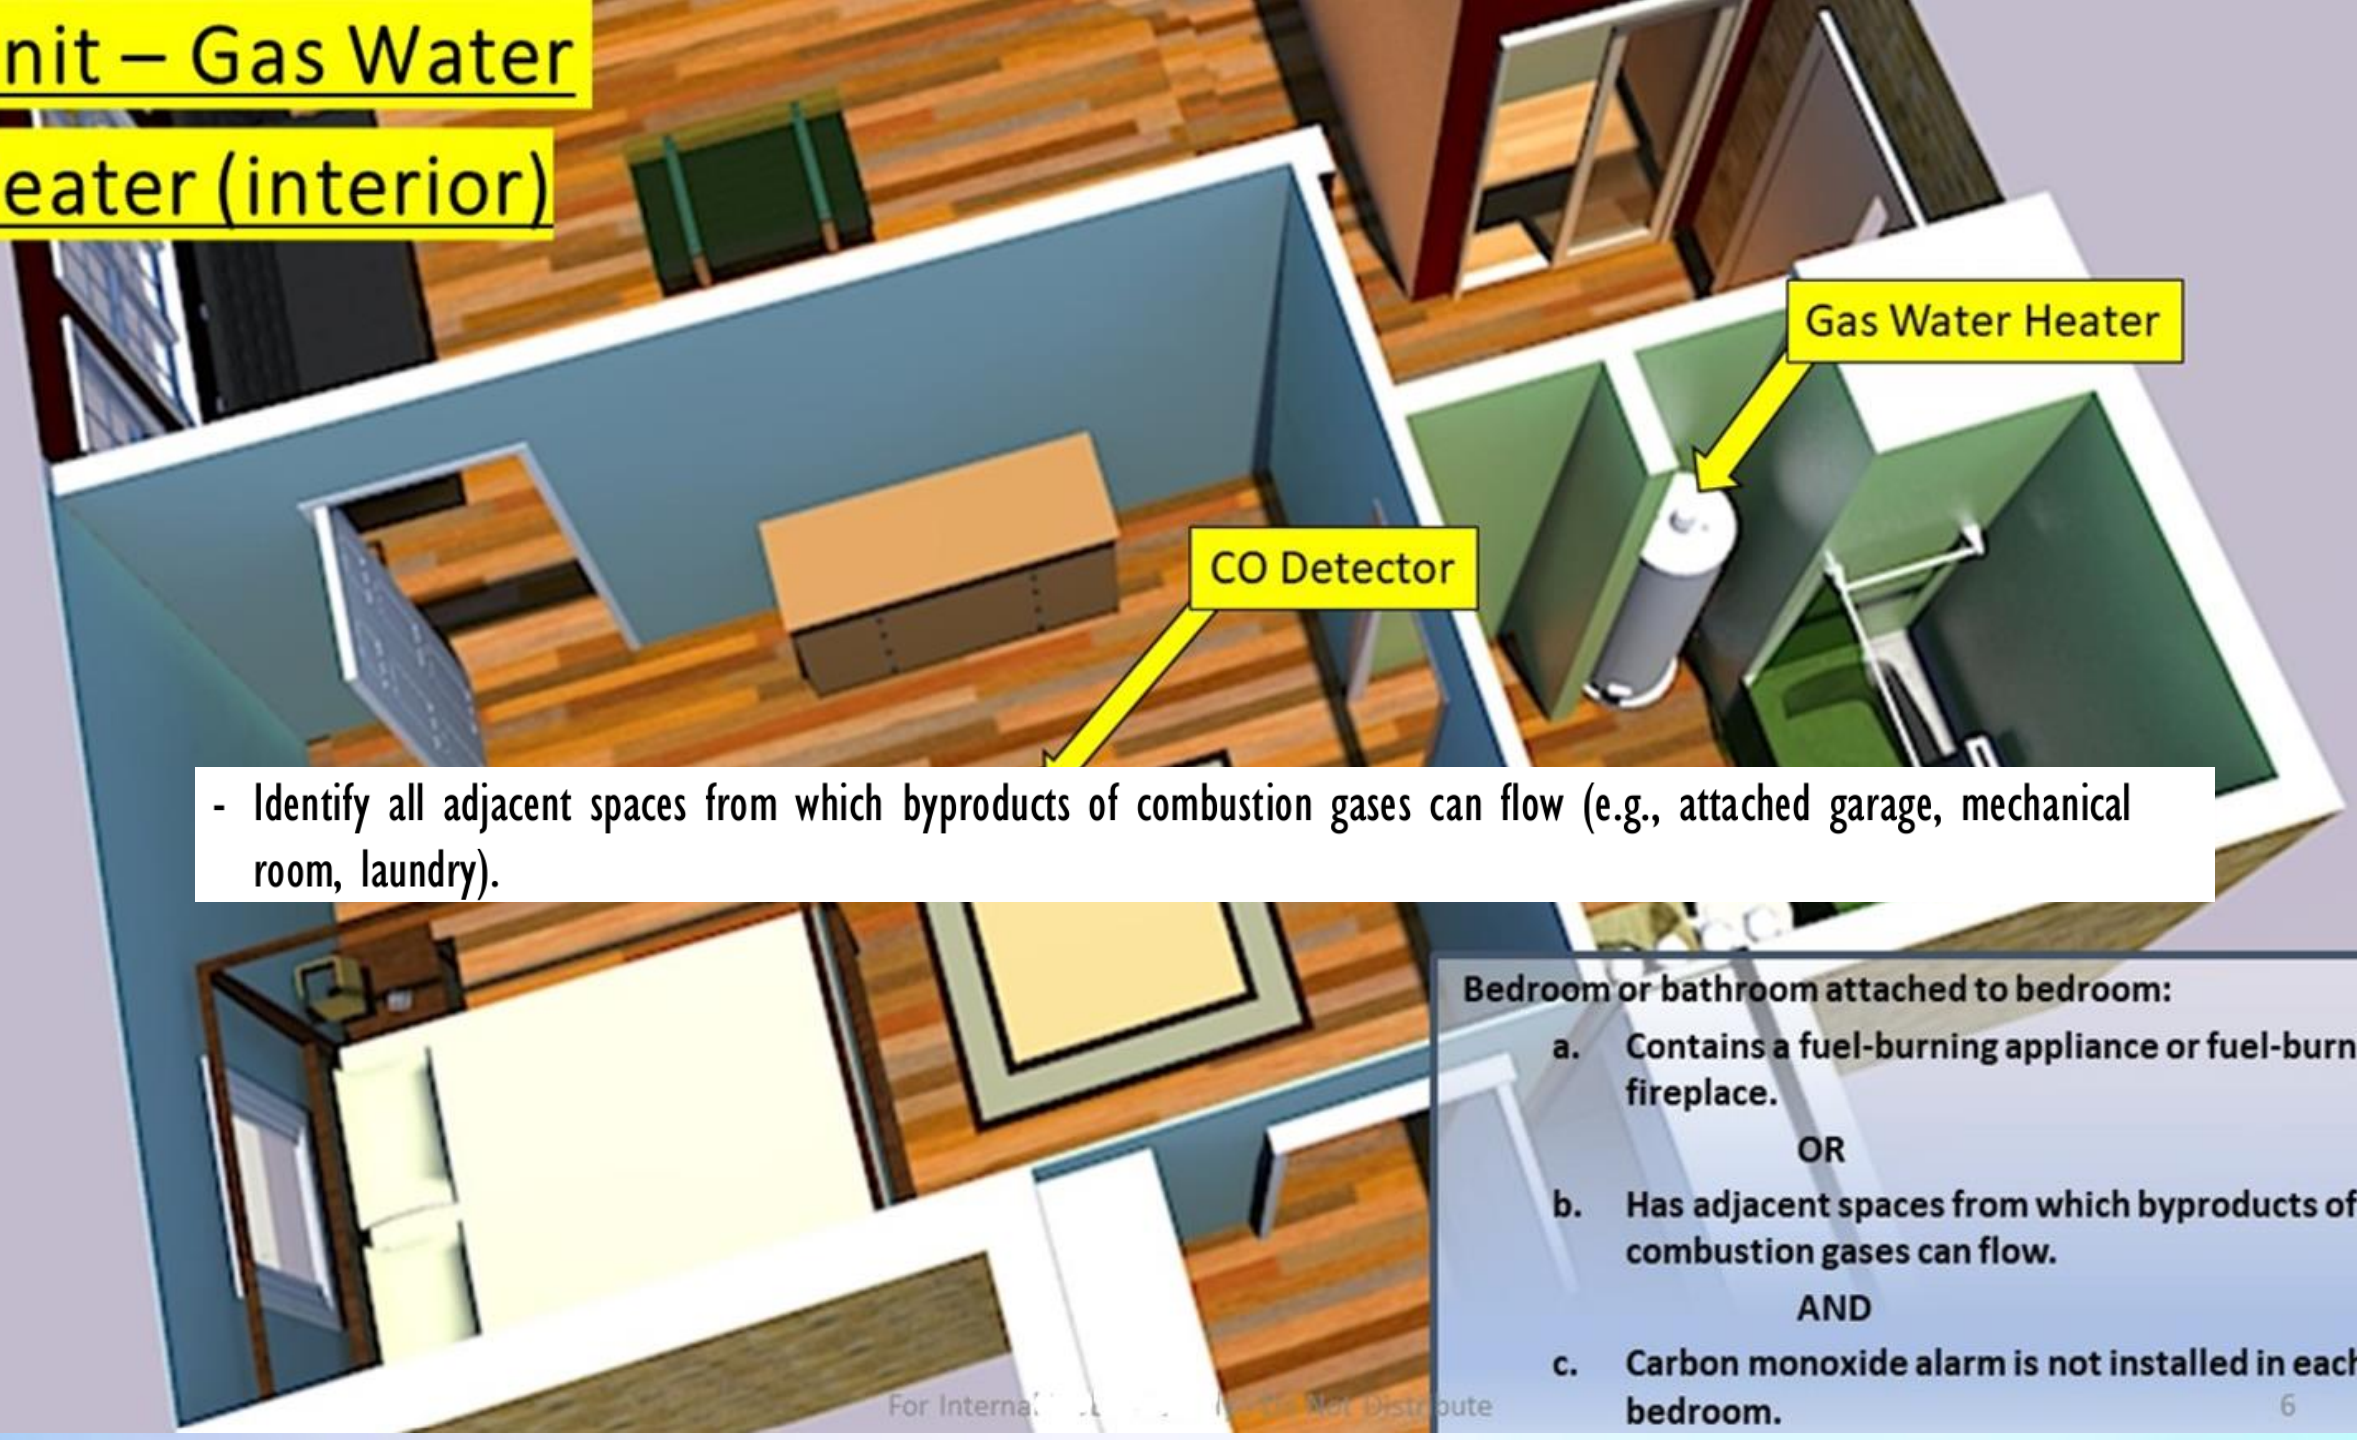


Gas Water Heater

CO Detector

- Identify all adjacent spaces from which byproducts of combustion gases can flow (e.g., attached garage, mechanical room, laundry).

- Bedroom or bathroom attached to bedroom:
- a. Contains a fuel-burning appliance or fuel-burning fireplace.
 - OR
 - b. Has adjacent spaces from which byproducts of combustion gases can flow.
 - AND
 - c. Carbon monoxide alarm is not installed in each bedroom.

**Unit – Fuel Burning
Furnace (ductwork)**

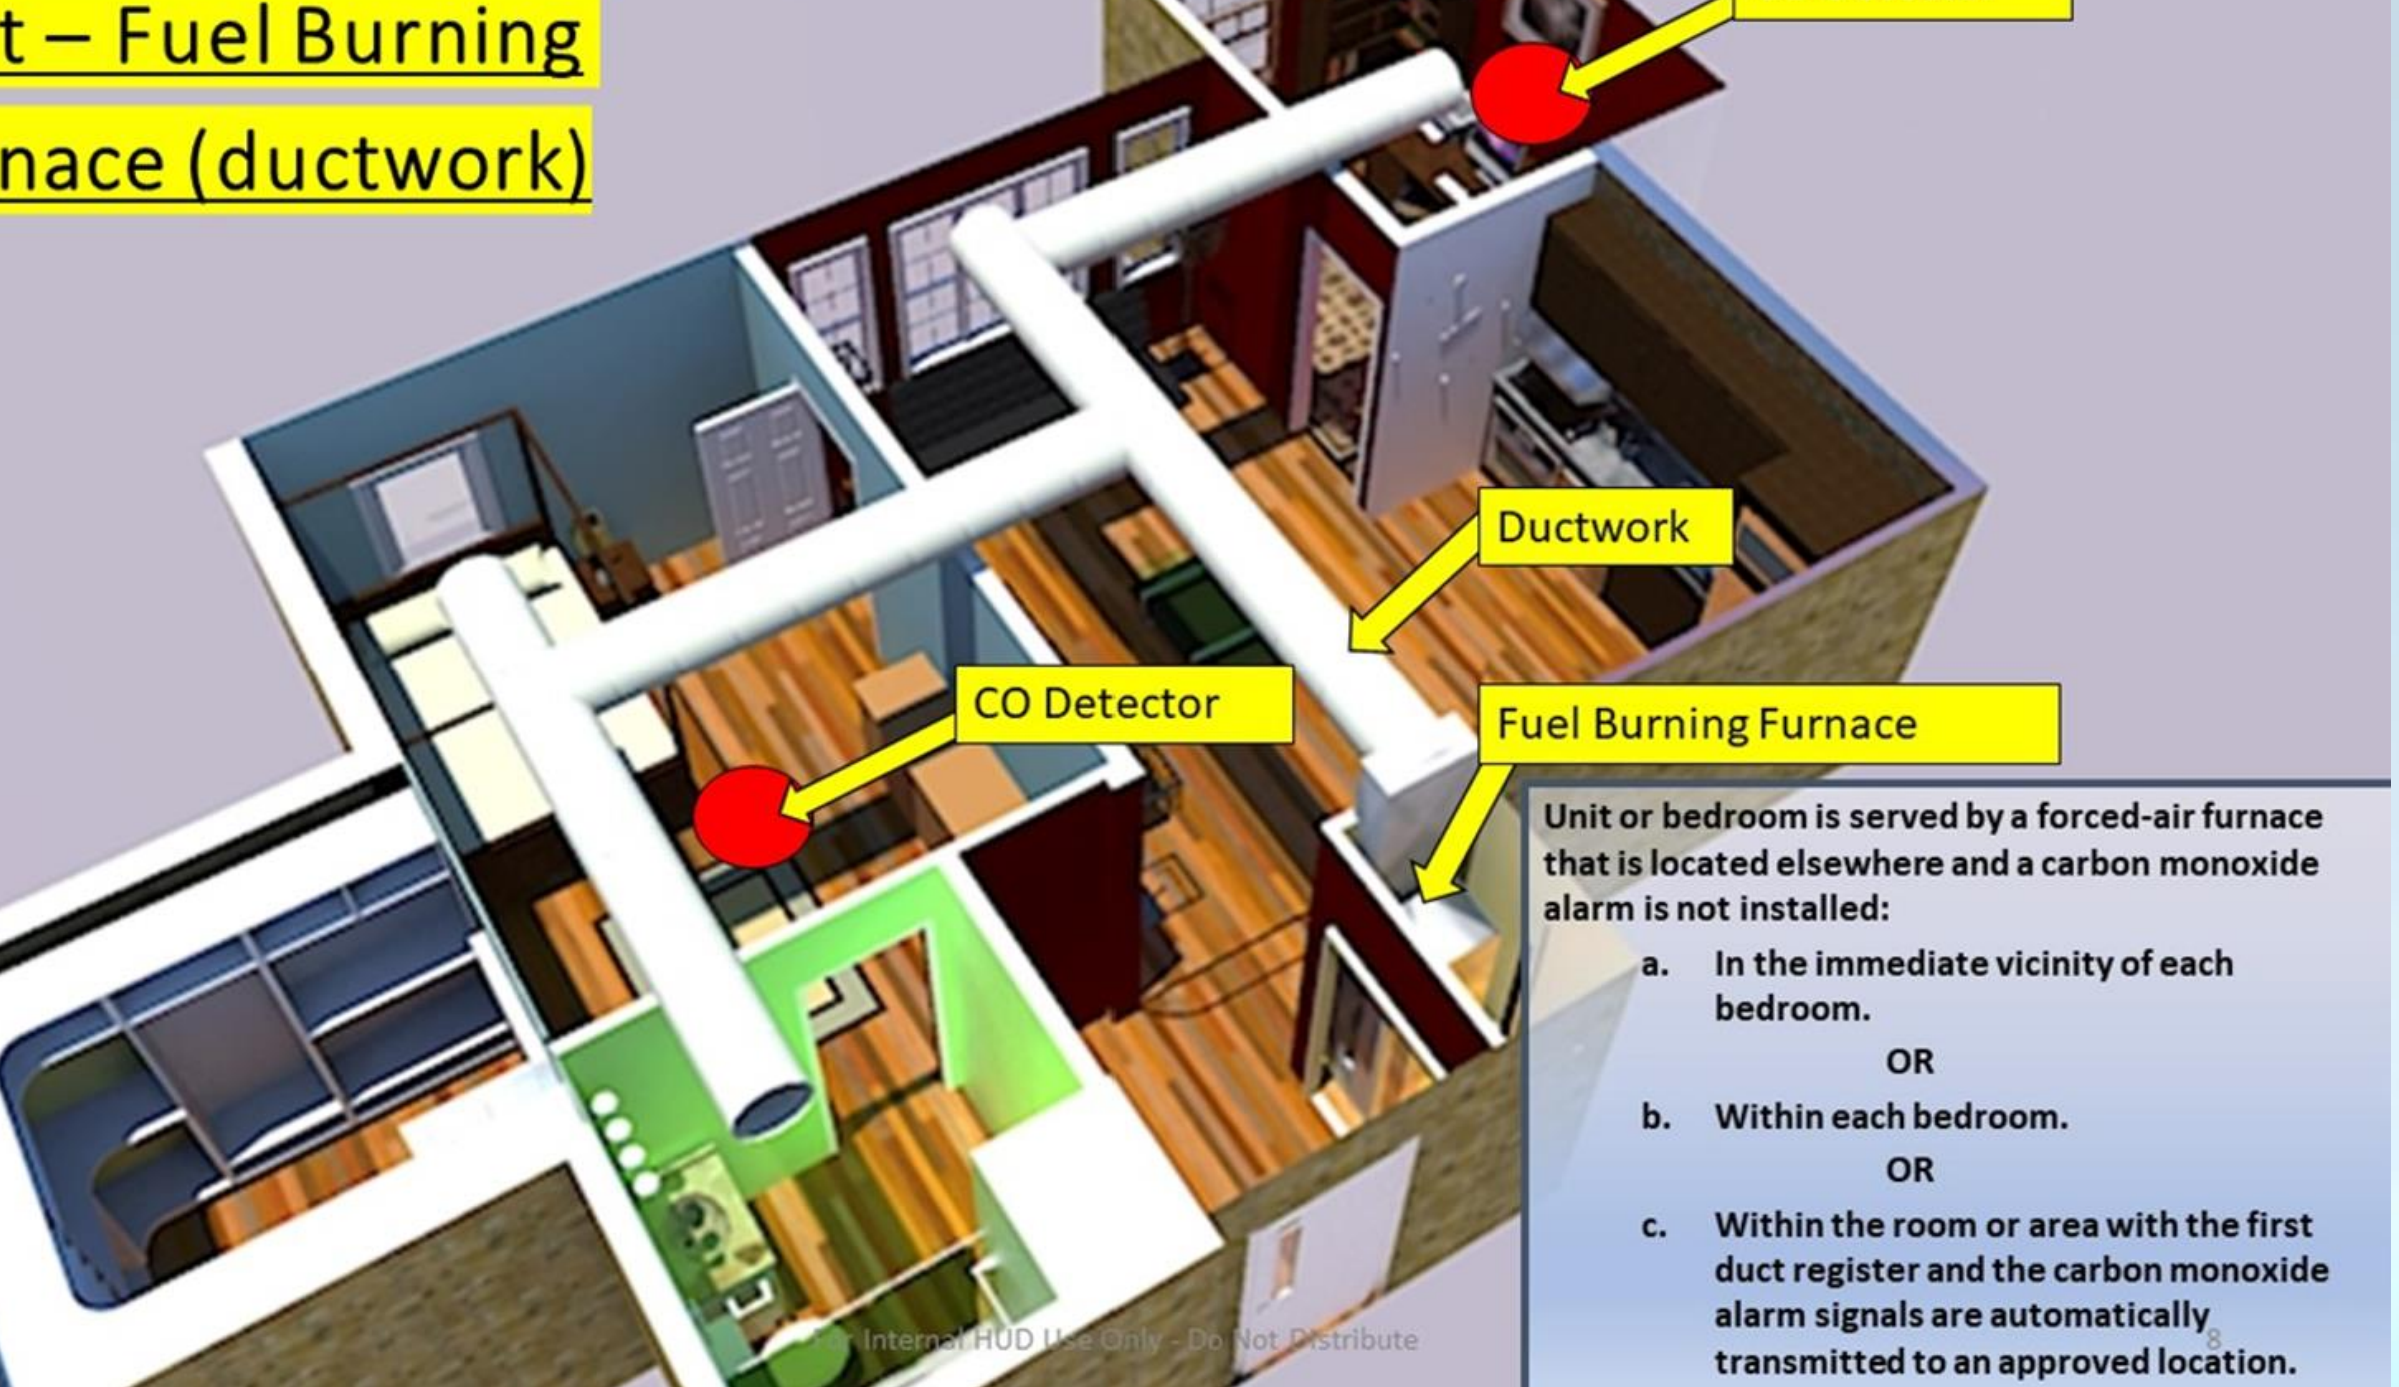

Ductwork


CO Detector

Fuel Burning Furnace

Unit or bedroom is served by a forced-air furnace that is located elsewhere and a carbon monoxide alarm is not installed:

- a. In the immediate vicinity of each bedroom.
OR
- b. Within each bedroom.
OR
- c. Within the room or area with the first duct register and the carbon monoxide alarm signals are automatically transmitted to an approved location.

Unit – Gas Water Heater (exterior)

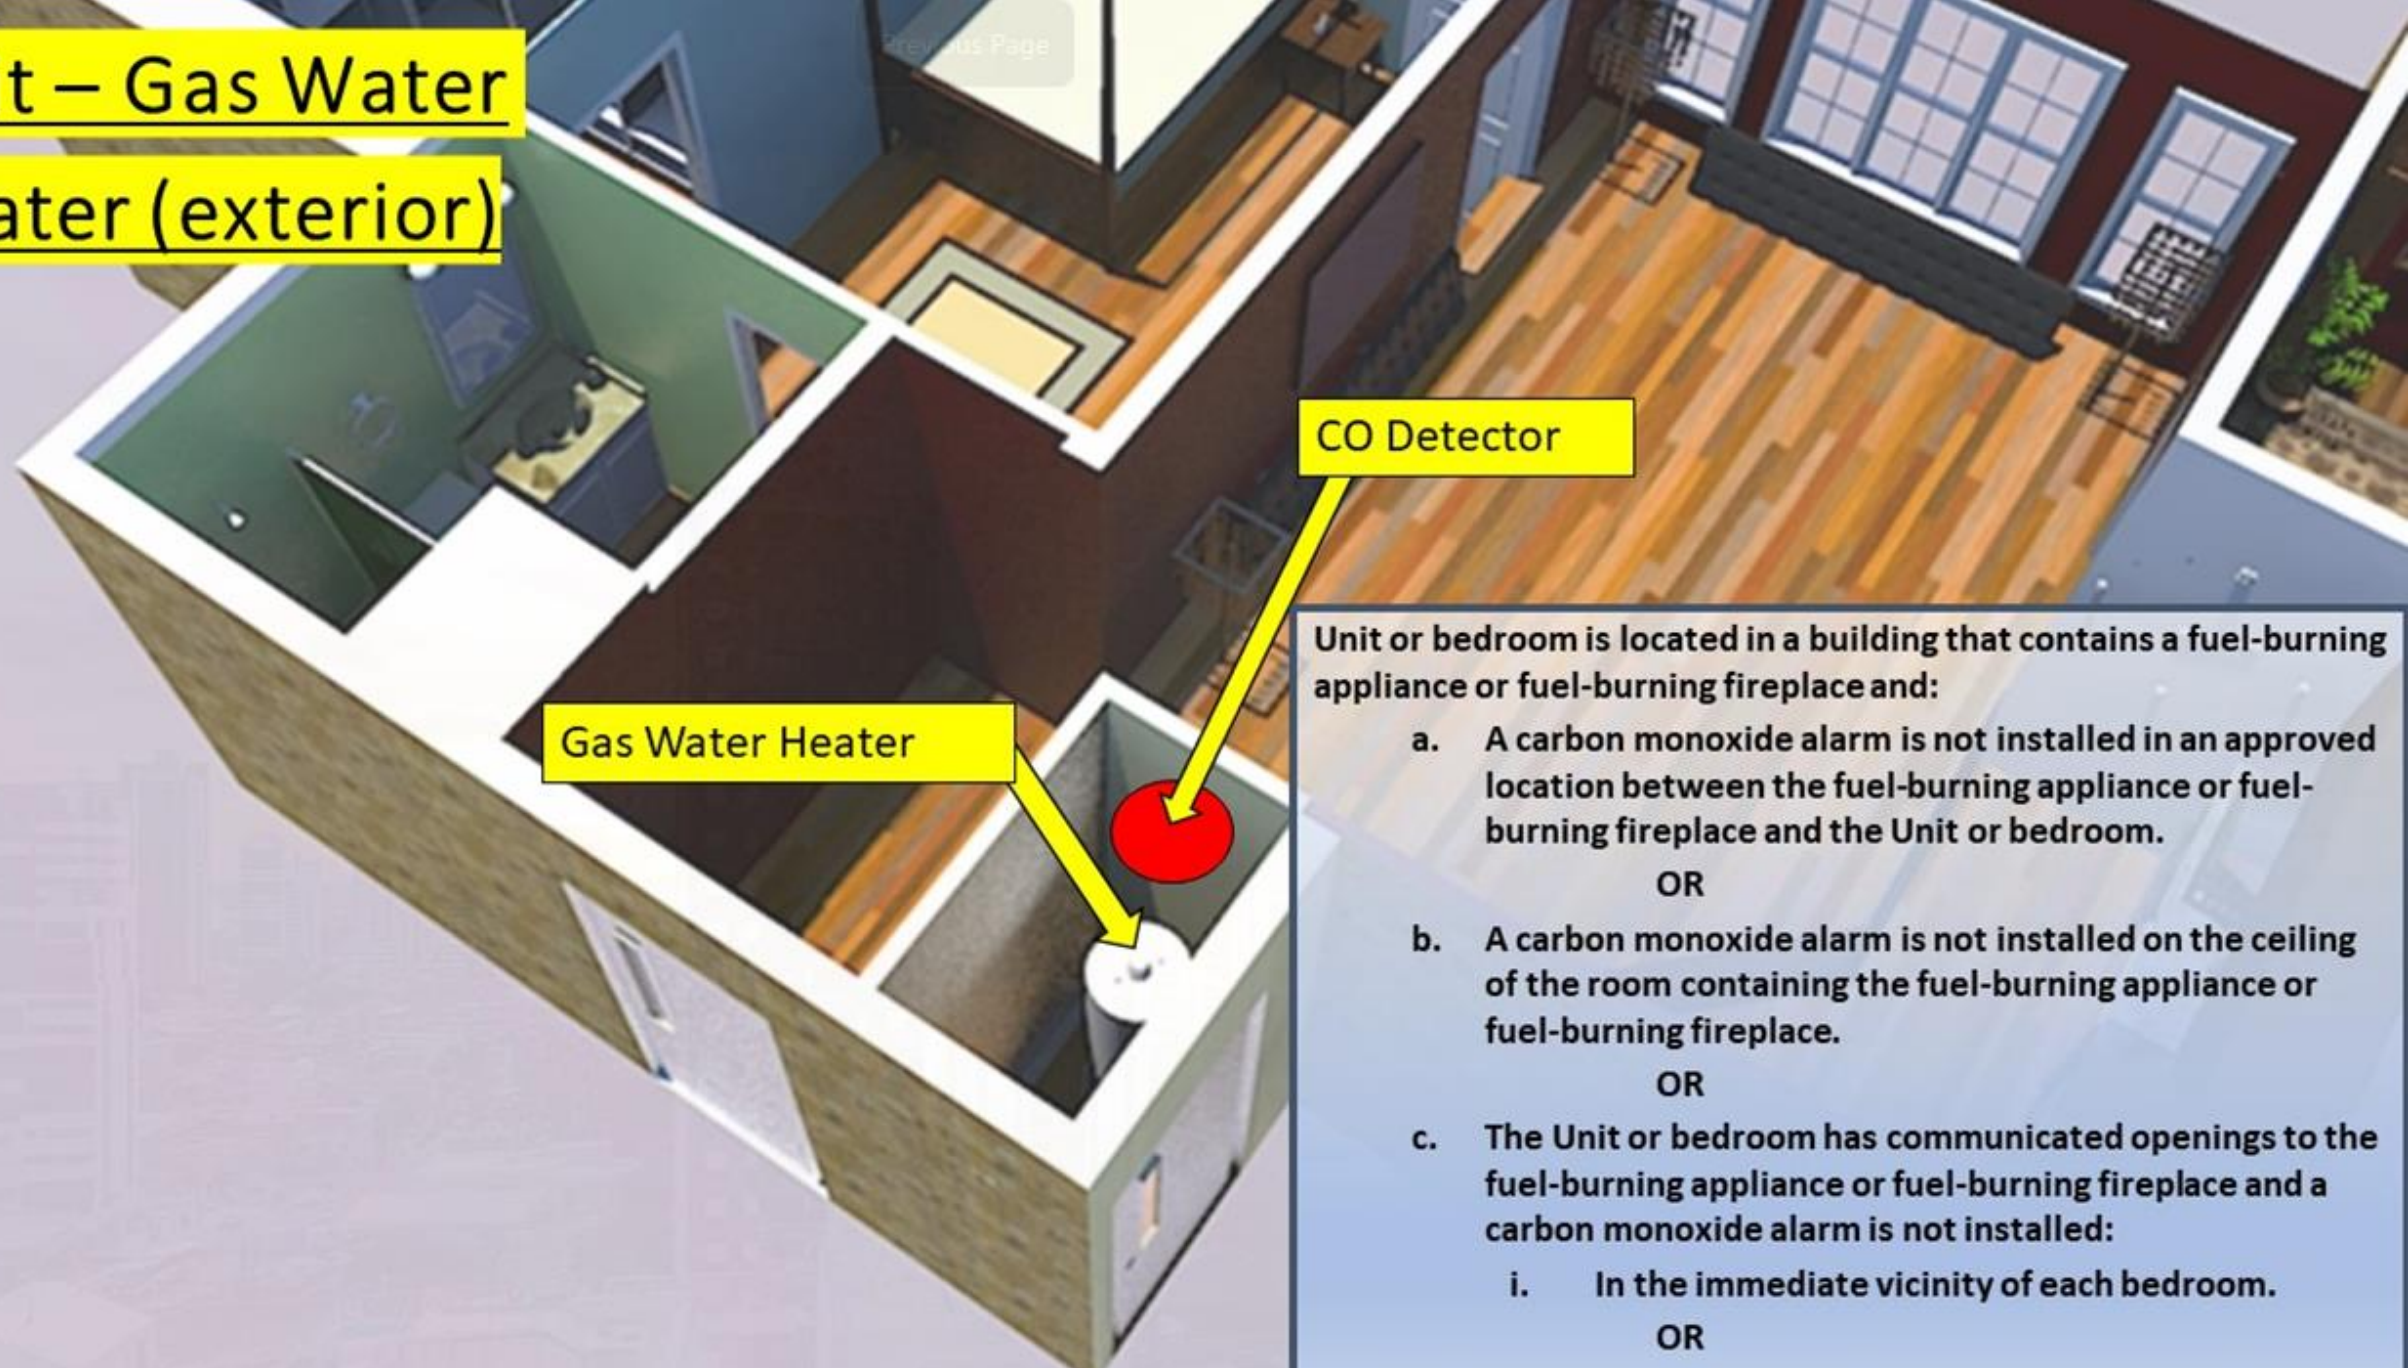


Gas Water Heater

CO Detector

Unit or bedroom is located in a building that contains a fuel-burning appliance or fuel-burning fireplace and:

- a. A carbon monoxide alarm is not installed in an approved location between the fuel-burning appliance or fuel-burning fireplace and the Unit or bedroom.
OR
- b. A carbon monoxide alarm is not installed on the ceiling of the room containing the fuel-burning appliance or fuel-burning fireplace.
OR
- c. The Unit or bedroom has communicated openings to the fuel-burning appliance or fuel-burning fireplace and a carbon monoxide alarm is not installed:
 - i. In the immediate vicinity of each bedroom.
OR
 - ii. Within each bedroom.


Inside – Boiler (floor plan)

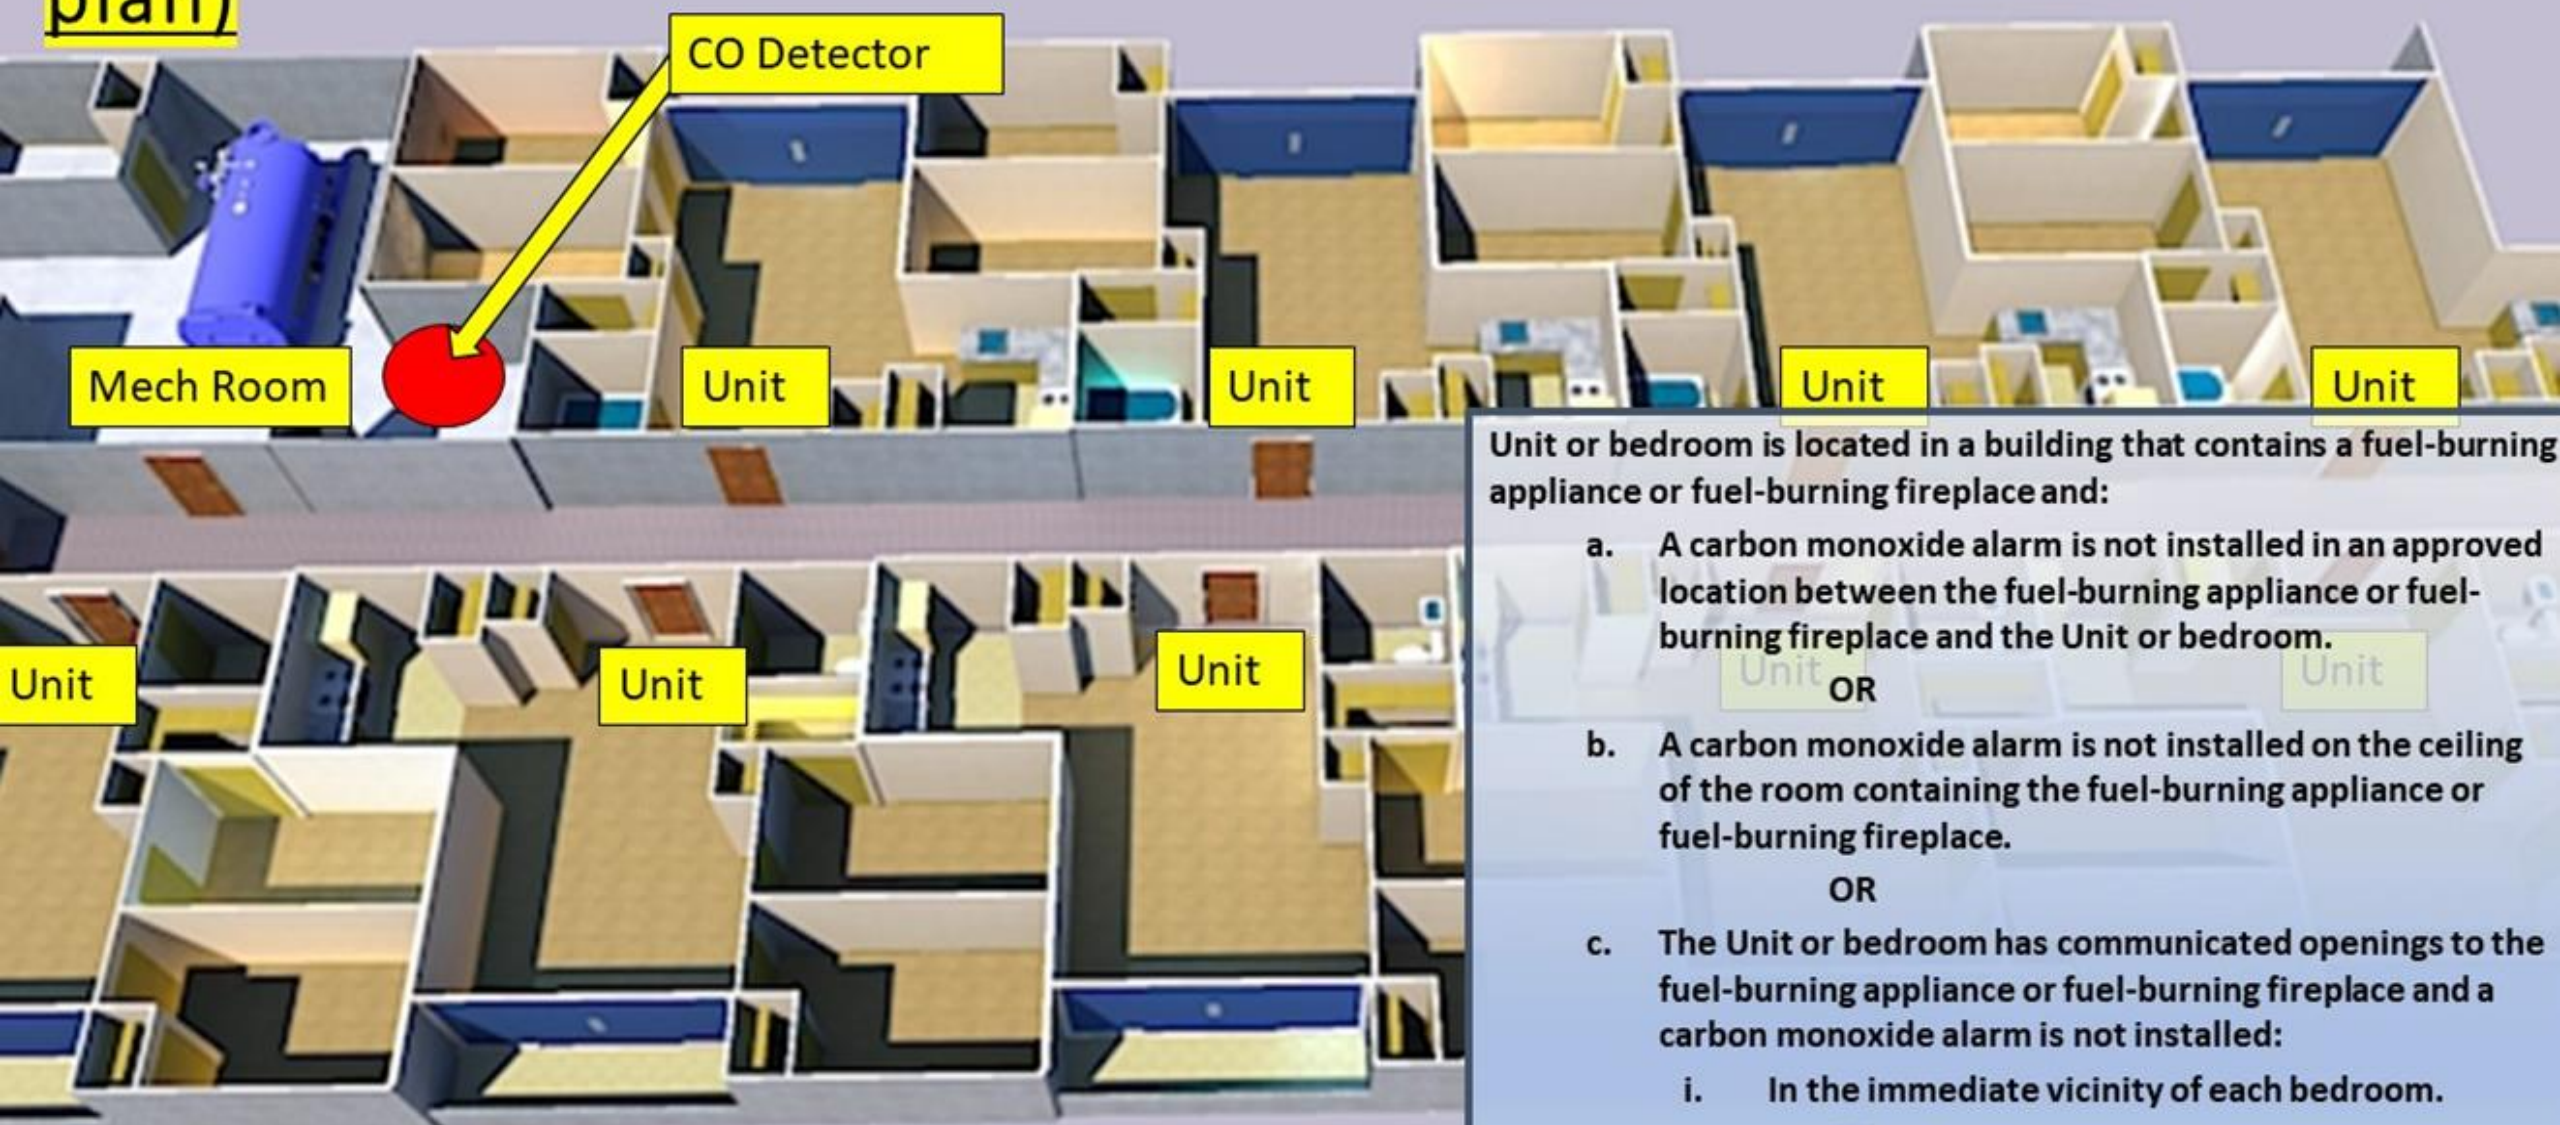

Unit or bedroom is located in a building that contains a fuel-burning appliance or fuel-burning fireplace and:

- a. A carbon monoxide alarm is not installed in an approved location between the fuel-burning appliance or fuel-burning fireplace and the Unit or bedroom.
- OR
- b. A carbon monoxide alarm is not installed on the ceiling of the room containing the fuel-burning appliance or fuel-burning fireplace.
- OR
- c. The Unit or bedroom has communicated openings to the fuel-burning appliance or fuel-burning fireplace and a carbon monoxide alarm is not installed:
 - i. In the immediate vicinity of each bedroom.
 - OR
 - ii. Within each bedroom.

Inside – Boiler (section view)

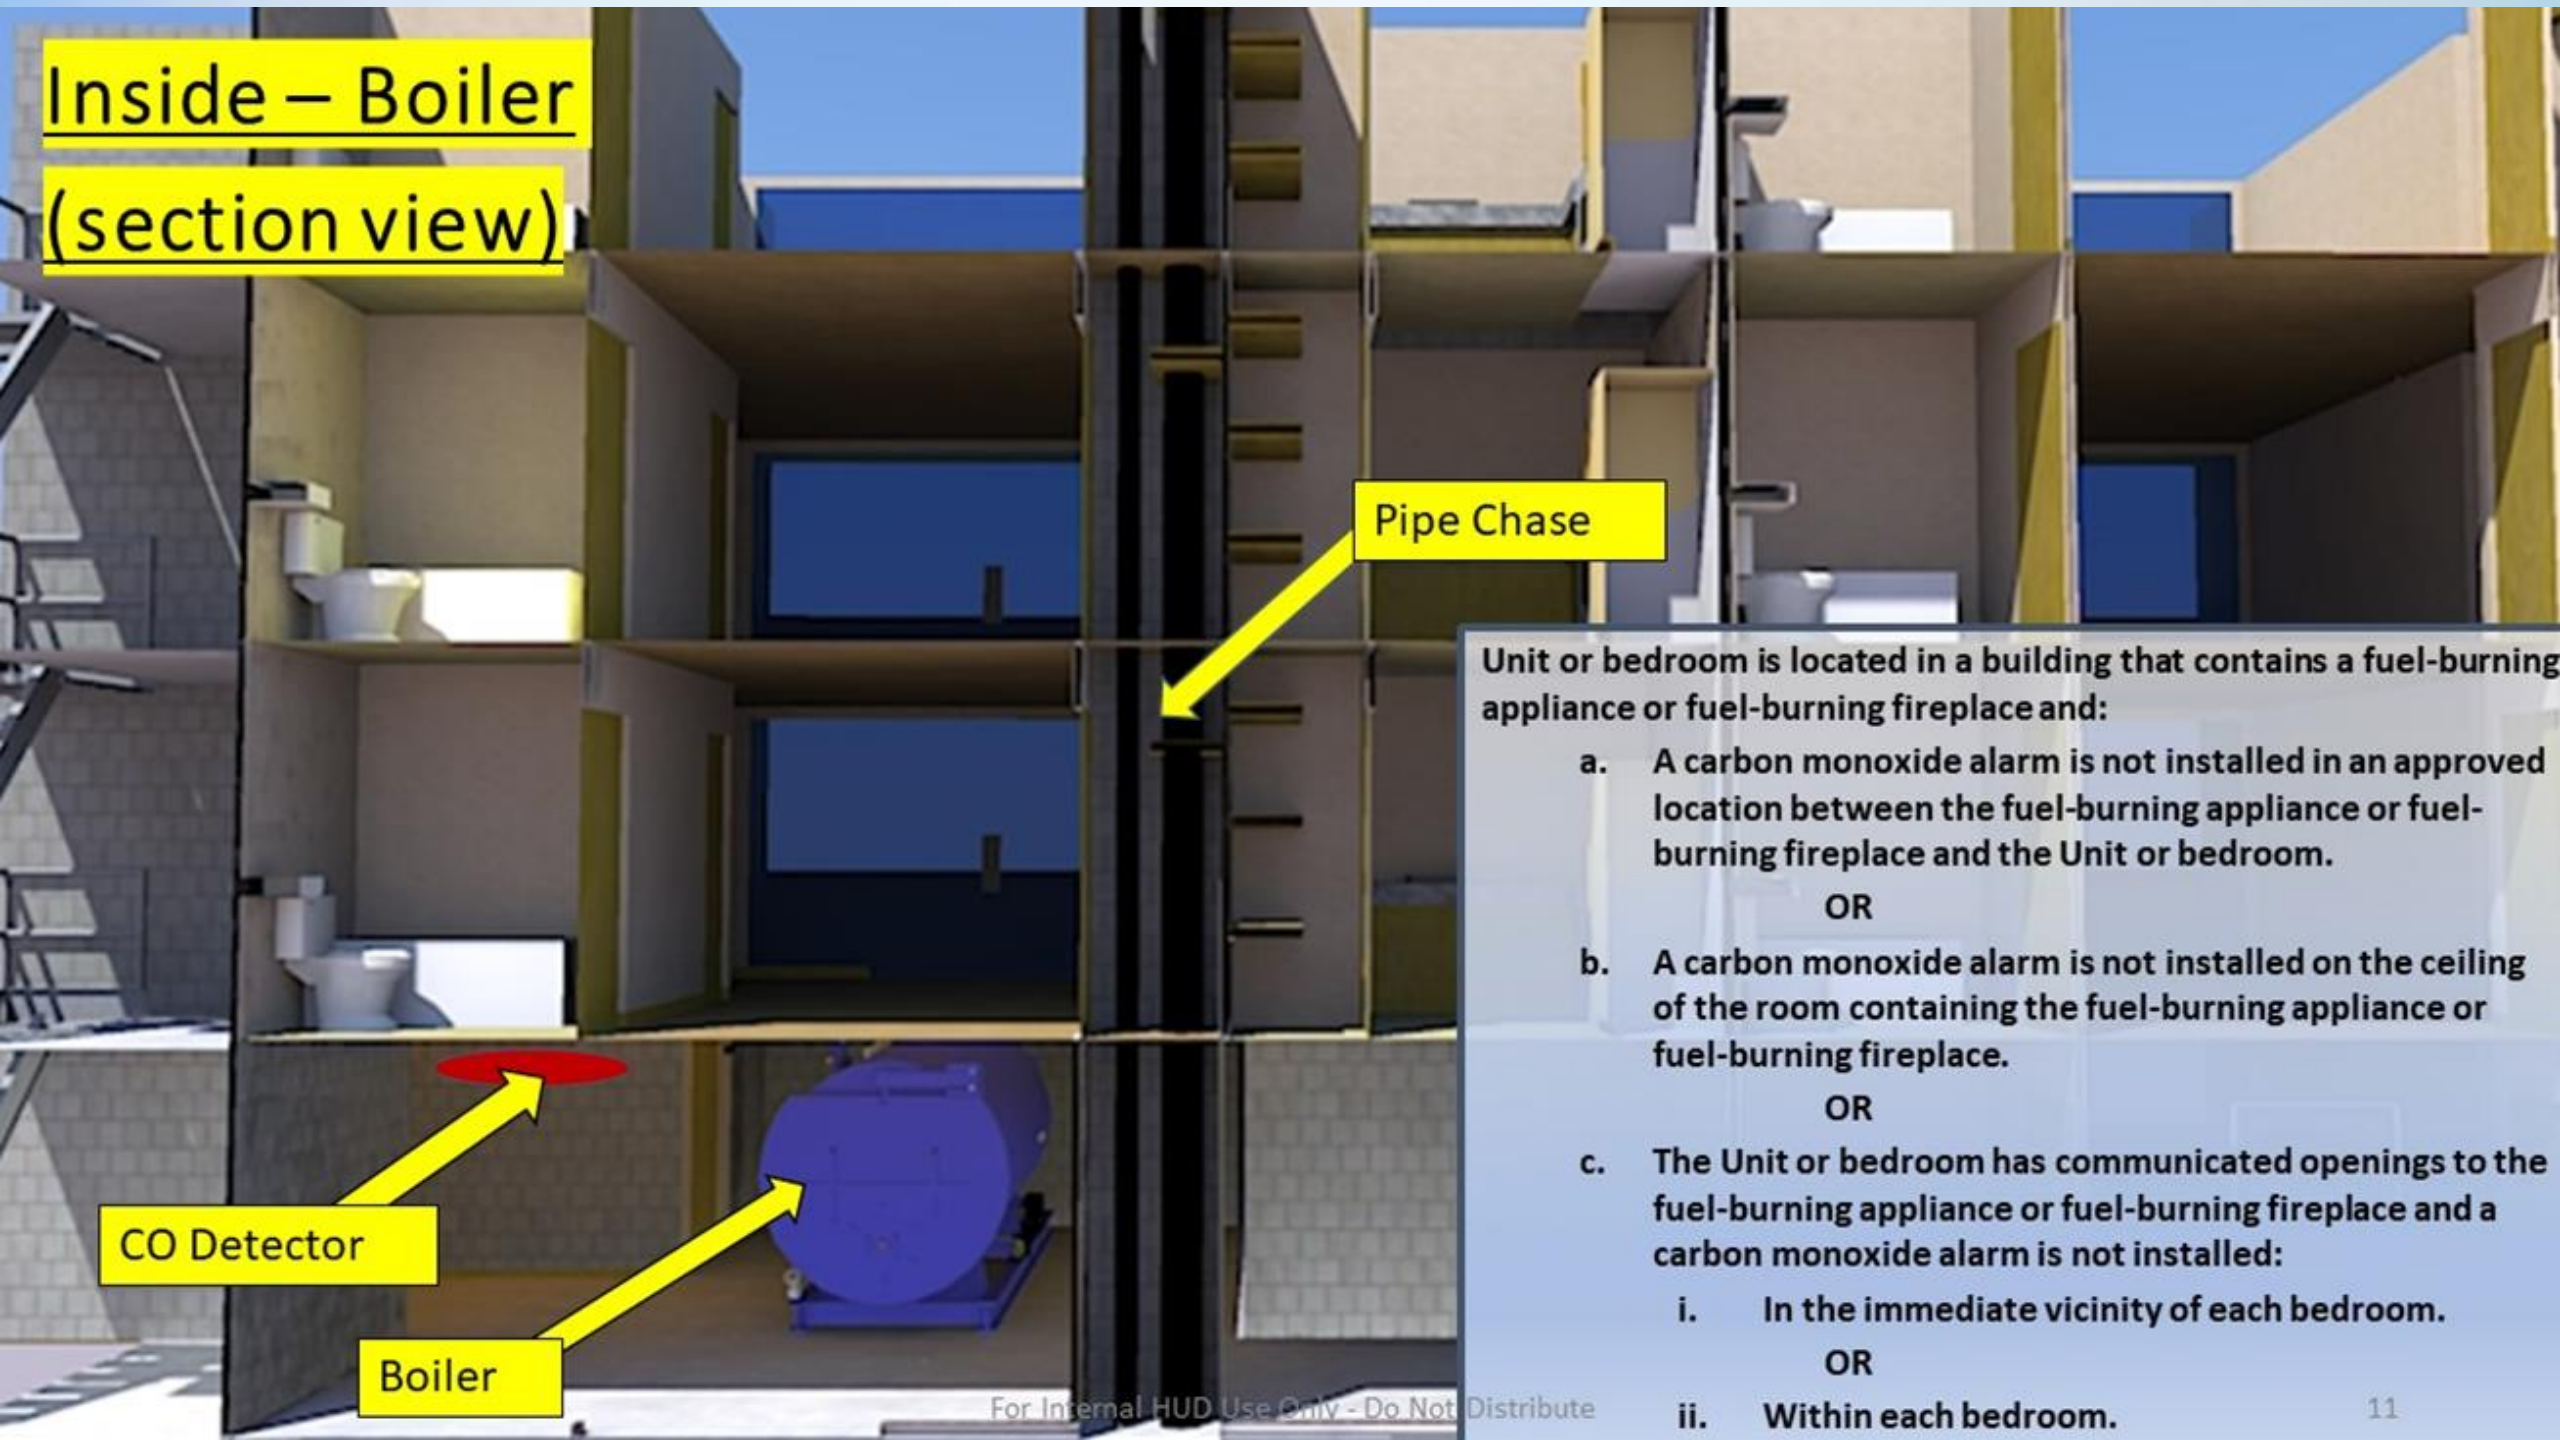

Pipe Chase

CO Detector

Boiler

Unit or bedroom is located in a building that contains a fuel-burning appliance or fuel-burning fireplace and:

- a. A carbon monoxide alarm is not installed in an approved location between the fuel-burning appliance or fuel-burning fireplace and the Unit or bedroom.

OR

- b. A carbon monoxide alarm is not installed on the ceiling of the room containing the fuel-burning appliance or fuel-burning fireplace.

OR

- c. The Unit or bedroom has communicated openings to the fuel-burning appliance or fuel-burning fireplace and a carbon monoxide alarm is not installed:

- i. In the immediate vicinity of each bedroom.

OR

- ii. Within each bedroom.